

NOT AVAILABLE COPY

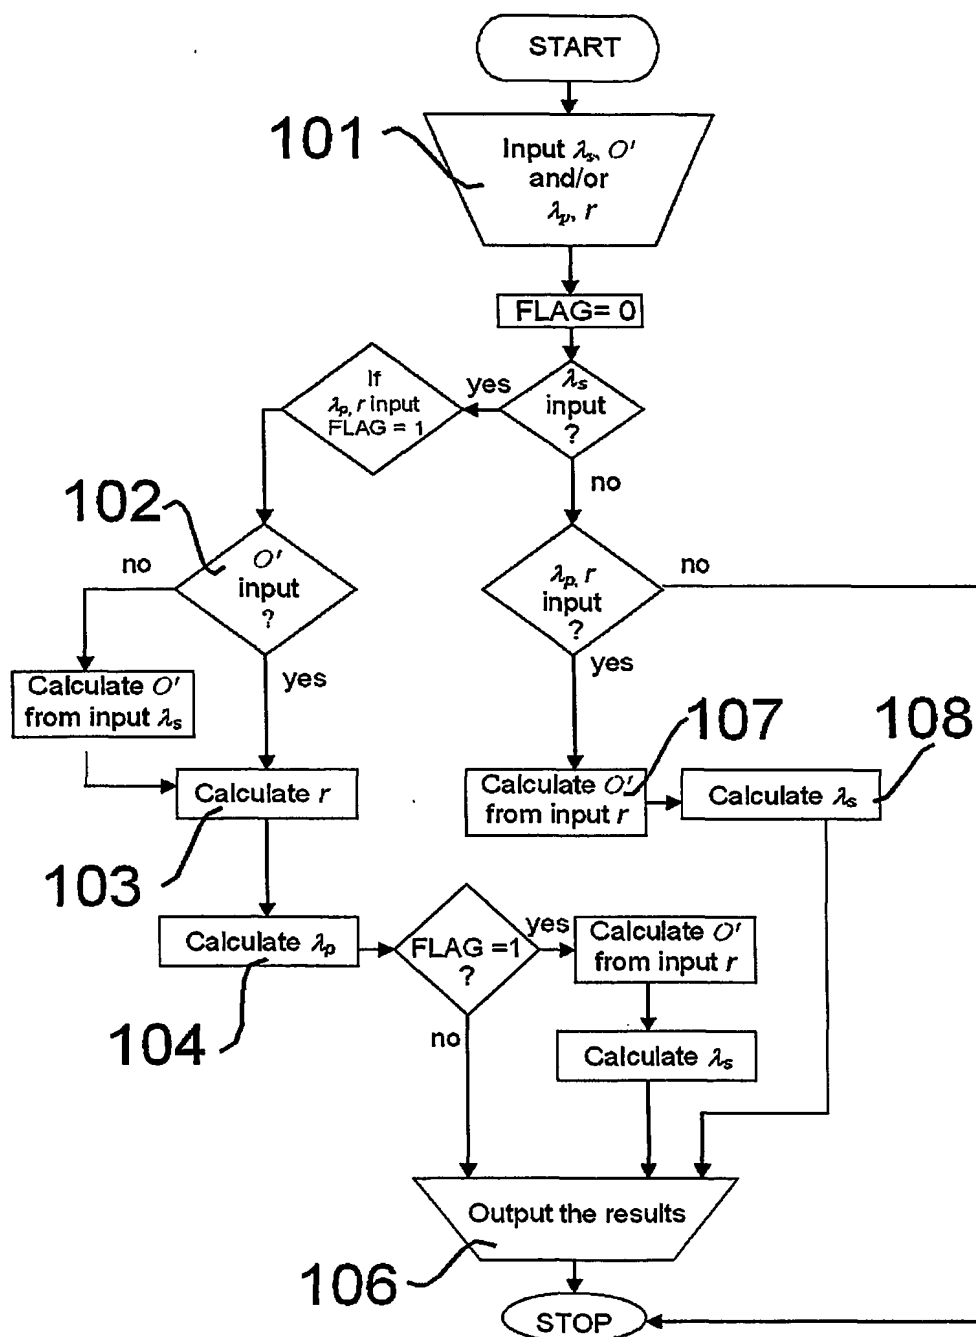


Fig. 1

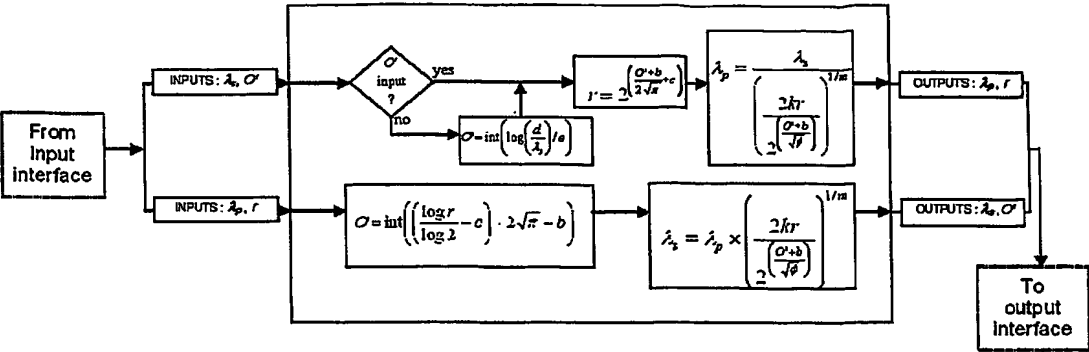


Fig. 2

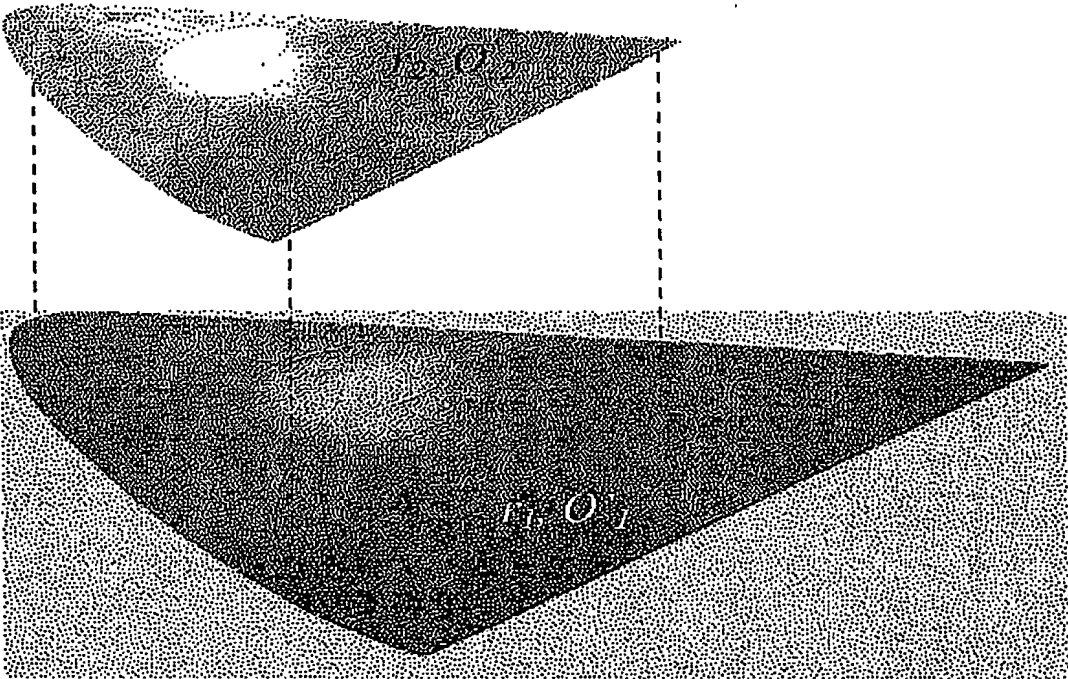


Fig. 3

PCT AVAILABLE CODE

EST AVAILABLE CODE

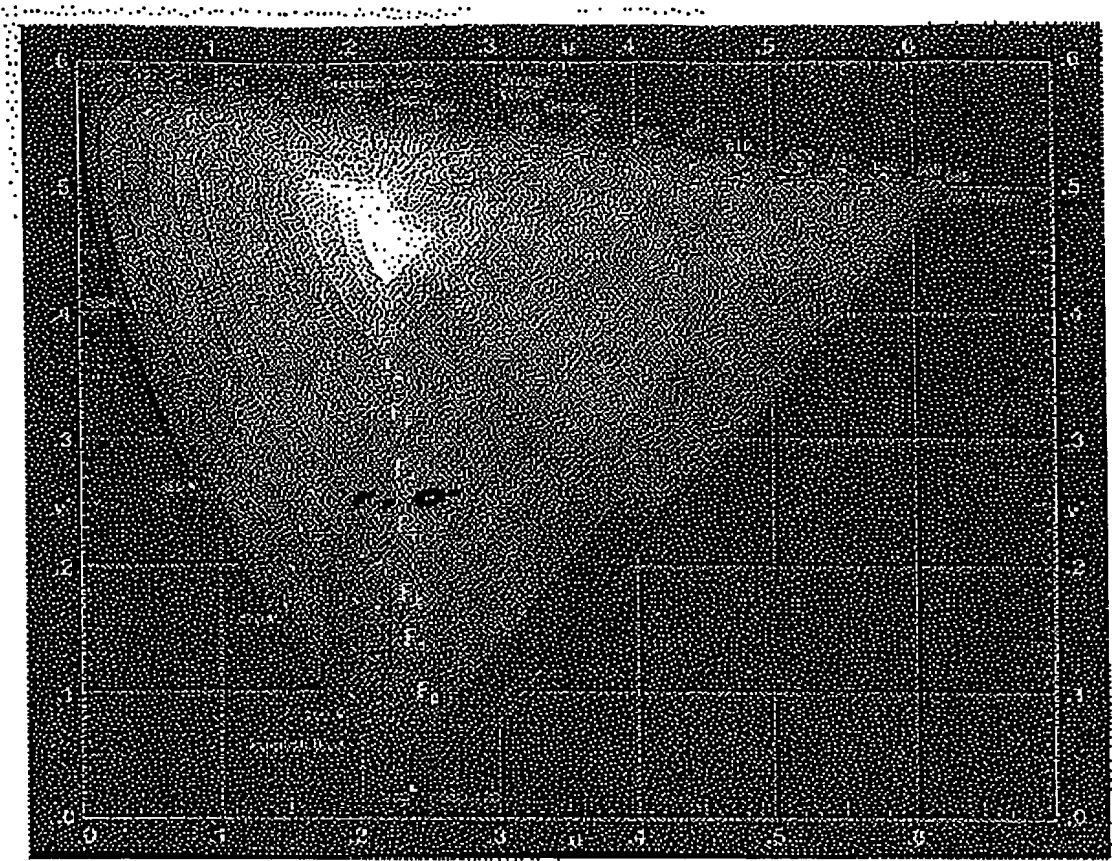


Fig. 4

EST AVAILABLE CODE

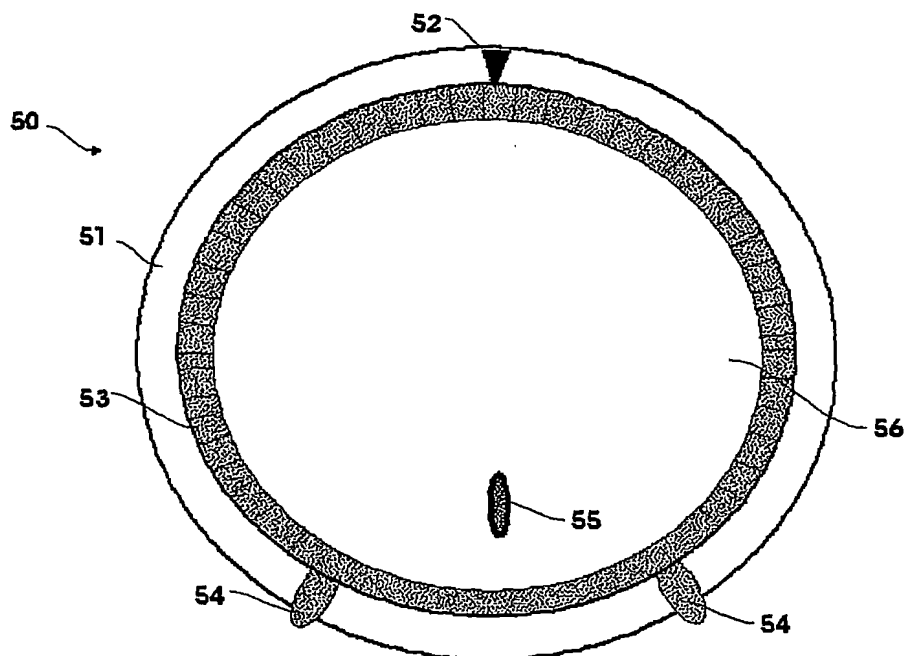


Fig. 5

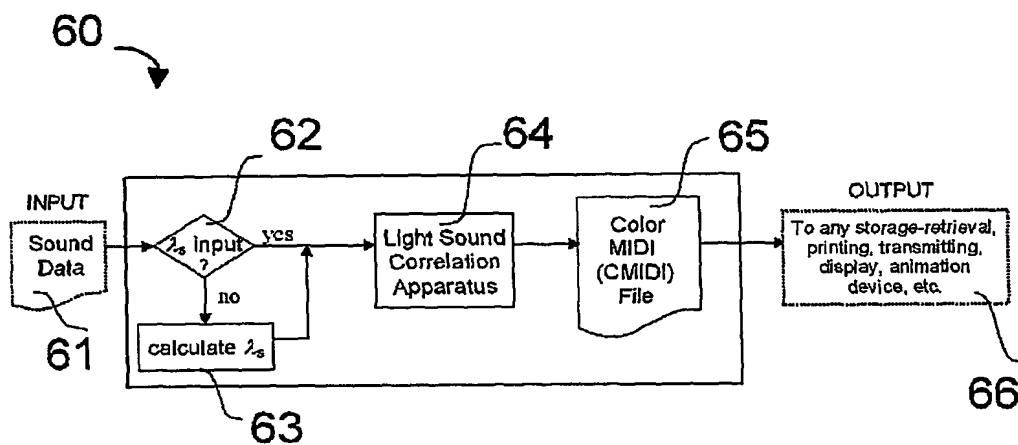


Fig. 6

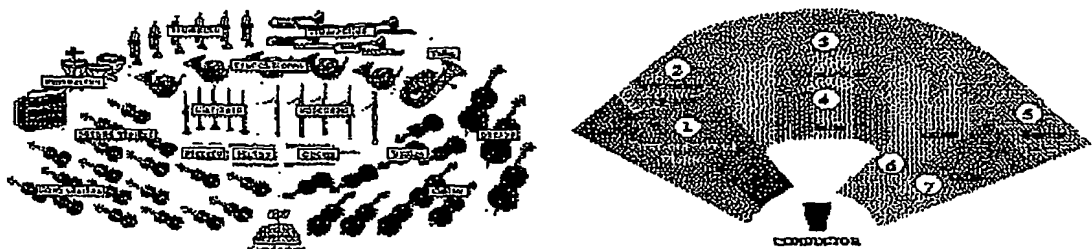


Fig. 7

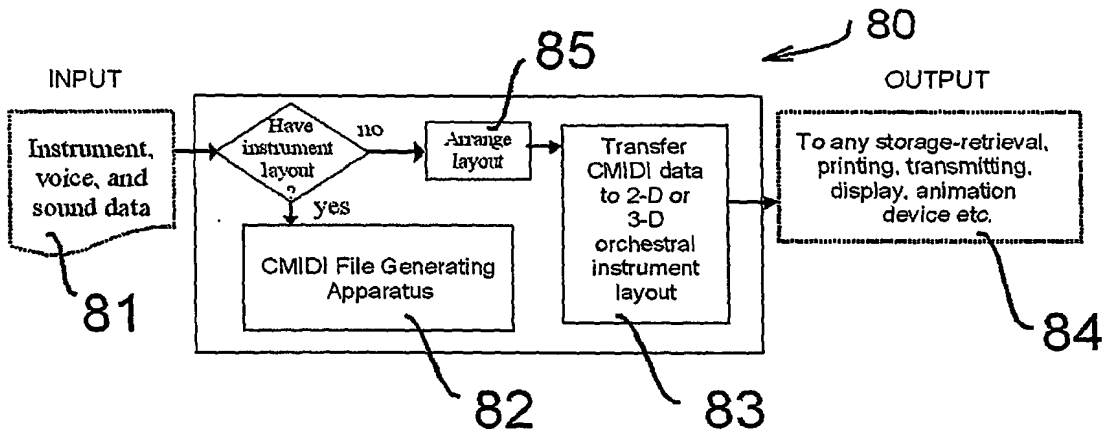


Fig. 8

BEST AVAILABLE COPY

Sequence #	Duration (s)	X	Y	O	N	X	Y	O	N	X	Y	O	N
51	0.3	9.9	04.30	C	4	3	04.5	C	4	3	B4.5.5	F	1
52	0.3	10.2	04.30	C	4	3	B4.5.5	A	2	24	Ce7.1.5	A	2
53	0.3	10.5	04.30	A	4	0	B4.5.5	C	2	21	Ce7.1.5	C	2
54	0.3	10.8	04.30	F	3	-1	B4.5.5	F	2	16	Ce7.1.5	F	2
55	0.15	10.86	04.30	F	3	-4	B4.5.5	C	2	21	Ce7.1.5	C	2
56	0.15	11.1	04.30	F	3	-1	B4.5.5	A	2	24	Ce7.1.5	A	2
57	0.15	11.36	04.30	F	3	-1	B4.5.5	F	1	28	Ce7.1.5	F	1
58	0.15	11.4	04.30	F	3	-4	B4.5.5	F	1	28	Ce7.1.5	F	1
59	0.15	11.66	04.30	A	4	0	B4.5.5	F	1	28	Ce7.1.5	F	1
60	0.15	11.7	04.30	A	4	0	B4.5.5	F	2	16	Ce7.1.5	F	2
61	0.15	11.86	04.30	C	4	3	B4.5.5	F	2	16	Ce7.1.5	F	2
62	0.15	12	04.30	C	4	3	B4.5.5	F	2	16	Ce7.1.5	F	2

Fig. 9

BEST AVAILABLE COPY

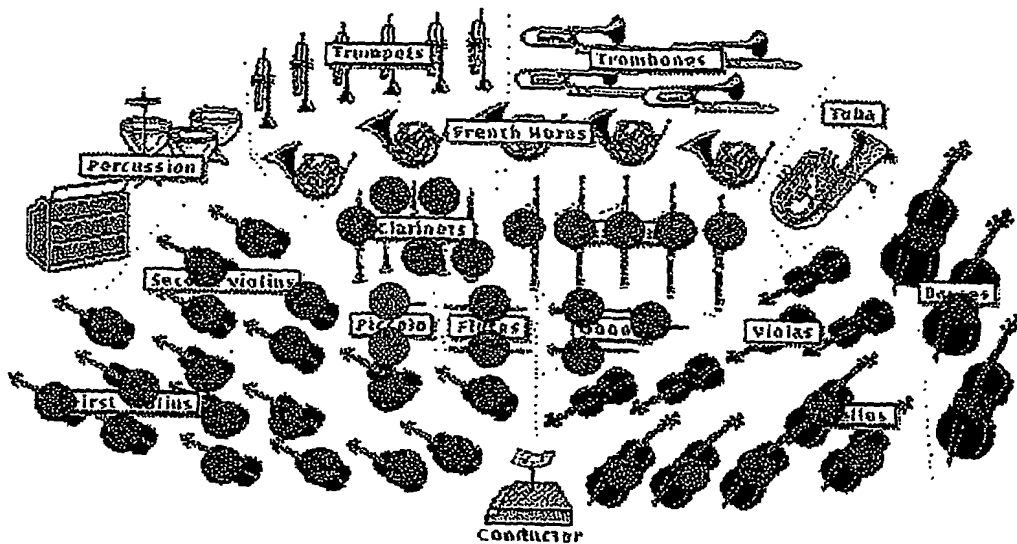


Fig. 10

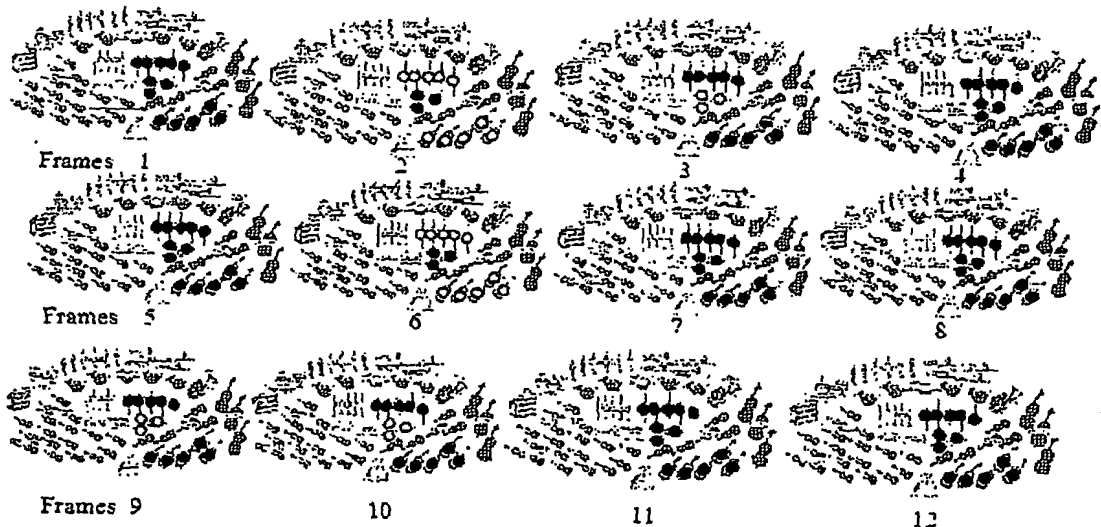


Fig. 11

BEST AVAILABLE COPY

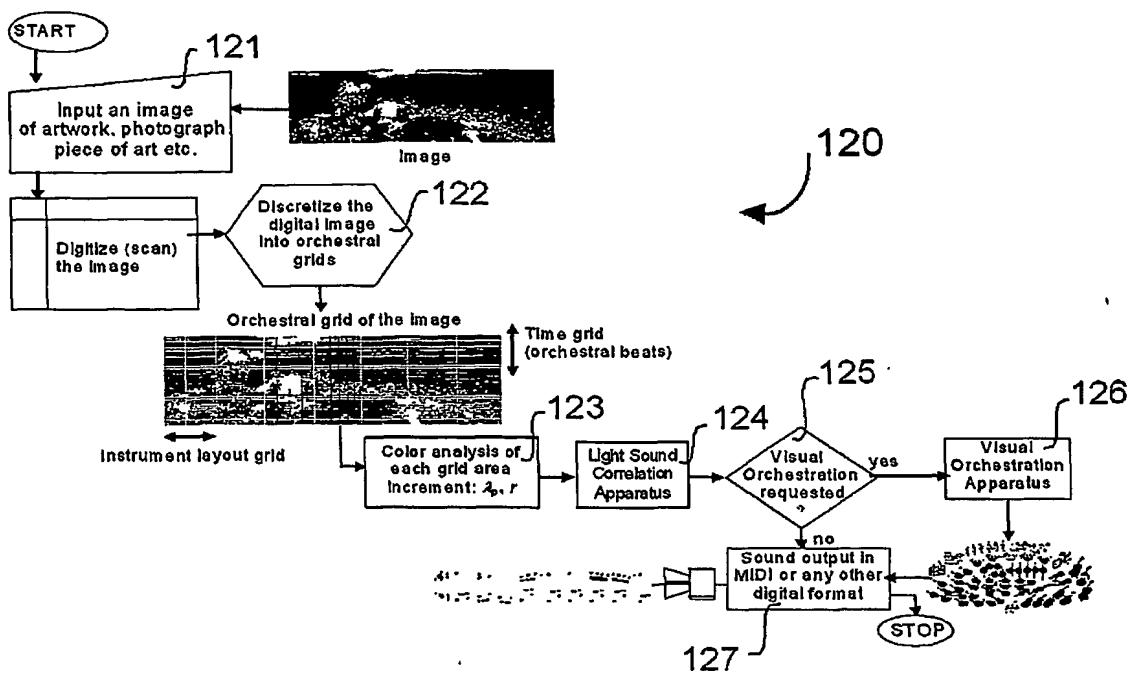


Fig. 12

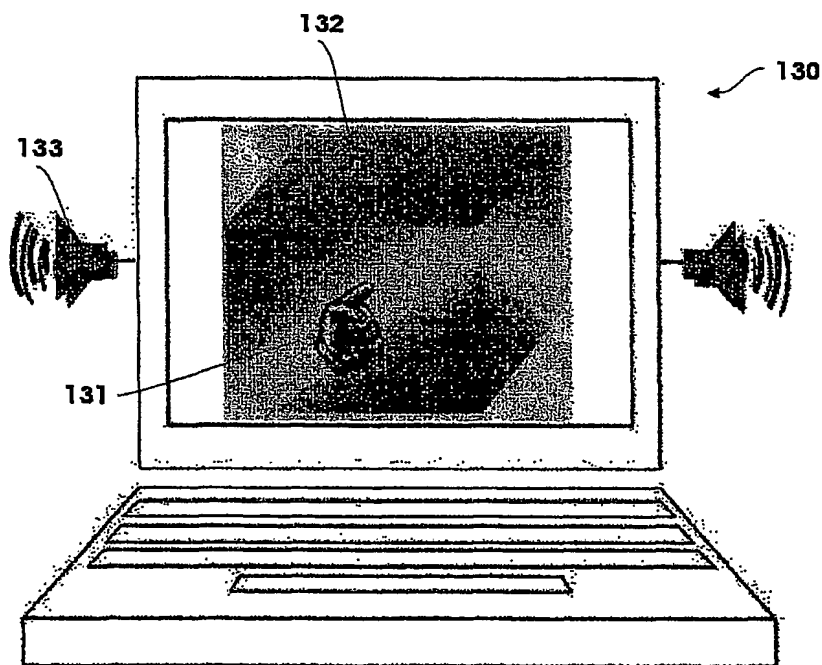


Fig. 13



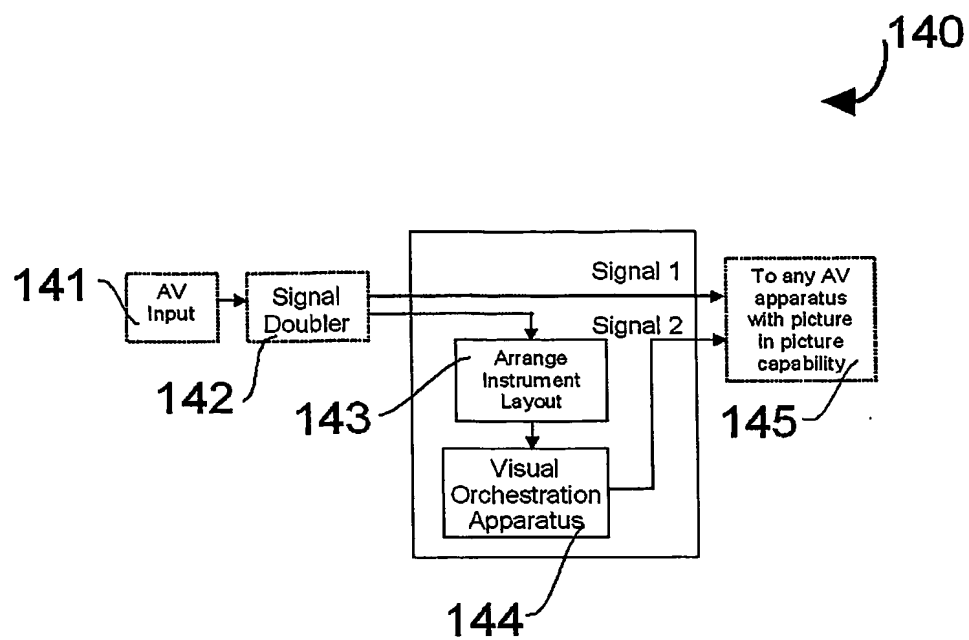


Fig. 14